

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION WITH POWER OFF.

CIRCUIT DIAGRAM No - REV

1656X94-05

TRANSFORMER TAPPING OPTIONS

Pt No 33653 (TYPE AA)

TAP	NOM 50/60HZ	50HZ	60HZ
W	220/230	176-242	198-259
X	380/400	304-418	342-446
Y	415/420	332-457	374-487
Z	440/460	352-484	396-517

FUSE QF2 - 250mA ANTI-SURGE

Pt No 33642 (TYPE BB)

TAP	NOM 50/60HZ	50HZ	60HZ
W	346/380	285-388	321-419
X	480/500	406-552	432-564
Y	240/240	192-261	216-282
Z*	550/575	445-605	501-654

FUSE QF2 - 250mA ANTI-SURGE

* 150mA ANTI-SURGE

Pt No 31836 (TYPE C)

TAP	NOM 50/60HZ	50HZ	60HZ
X	660/660	534-726	600-726

FUSE QF2 - 150mA ANTI-SURGE

ALL TRANSFORMER TYPES - QF4 500mA SLOW BLOW
WHEN FITTED QF1 AND QF3 WILL BE AS QF2.

MAX EXTERNAL LOAD ON TERMINALS 4 & 5 TO BE EVA.

O - OPEN
C - CLOSE

C1 & C2 - CONTACTOR COILS.

T/L/S - TORQUE/LIMITSWITCH

AS1 - AUXILIARY LIMIT SWITCH MAKE CONTACT AT END OF TRAVEL

AS2 - AUXILIARY LIMIT SWITCH BREAK CONTACT AT END OF TRAVEL

WIRES ARE IDENTIFIED AT EACH END BY TERMINAL No. OR BY WIRE No. SHOWN

FOR TYPICAL REMOTE CONTROL INDICATING, MONITORING AND ALARM CIRCUITS SEE PUBLICATION AE4/2

CONTROL SIGNAL THRESHOLD VOLTAGES MAXIMUM 'OFF' 3V. MINIMUM CONTROL SIGNAL 300ms.

E. S. D. CONTROL SIGNAL VOLTAGE MUST BE EQUAL TO OR GREATER THAN ALL OTHER CONTROL SIGNAL VOLTAGES.

INDICATES SWITCH MADE

TORQUE AND LIMIT SWITCH OPERATION

SWITCH	OPEN	INTER	SHUT
OT/L5			
CT/L5			
CAS1			
CAS2			
OAS1			
OAS2			

ADD ON PAK 1 SWITCH OPERATION


SWITCH	OPEN	INTER	SHUT
IAS1			
IAS2			
IAS3			
IAS4			
IAS5			
IAS6			

INDICATES SWITCH MADE

ANALOGUE INPUTS (FOR DETAILS, SEE ROTORK PUBLICATION AE4/0.1)

MANUAL/AUTO. -ve (A) +ve

WHEN REMOTE SELECTION OF AUTO/MANUAL CONTROL IS REQUIRED, LINK 5-37 MUST BE REMOVED AND A REMOTE AUTO/MANUAL SWITCH FITTED ACROSS TERMINALS 5 37 SWITCH MADE FOR AUTO OPERATION

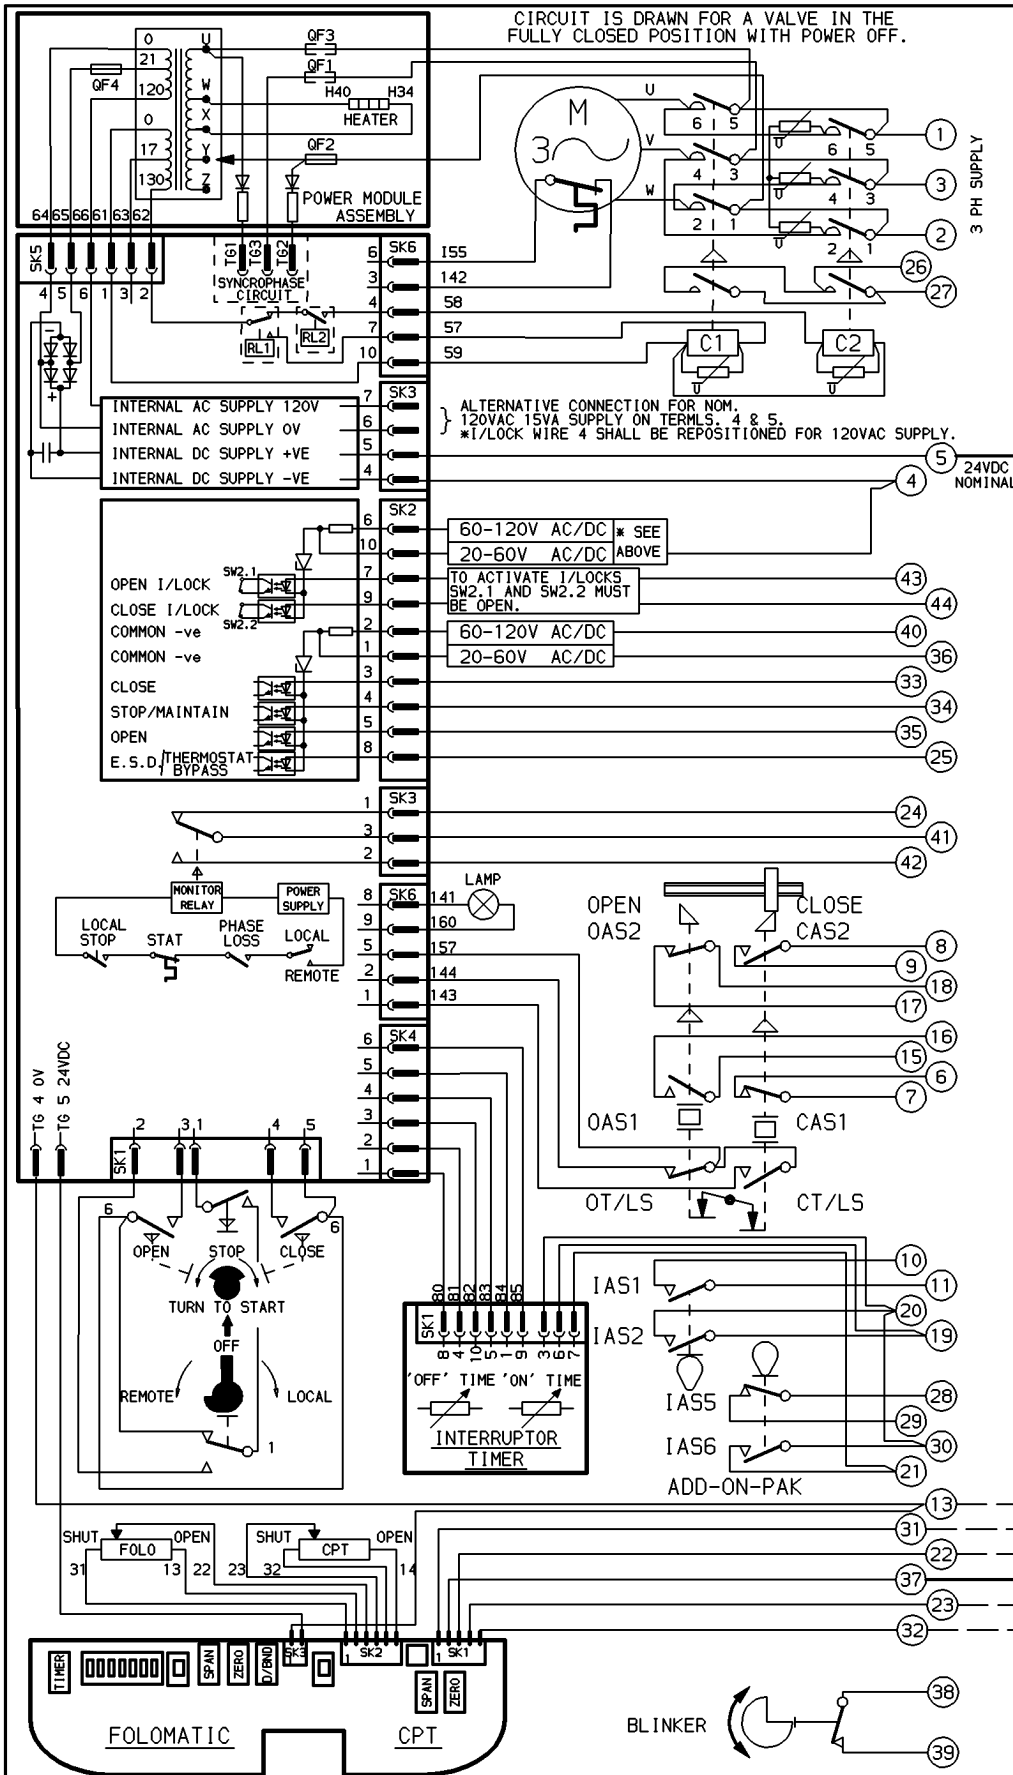

No	DATE	REVISION
05	120194 J.C	SIMILAR TO 1656X94 JOB No. --- AUTO/MANUAL MOD P2269 CHECKED P.J.W



ROTORK CONTROLS LTD
BATH ENGLAND, BA1 3JQ.
tel (0225) 428451

ROTORK CONTROLS INC
ROCHESTER, NY 14624.
tel (716) 328-1550

DRAWN T.A
DATE 110291

CHECKED K.S
DATE 110291

1600 MK5 + 2 POTS+FOLO
+CPT+4 SW AOP1+TIMER

CIRCUIT DIAGRAM No -REV

1656X94-05