


TRANSFORMER VOLTAGE SELECTION



SET SWITCH AS ABOVE FOR
198V - 264V SUPPLIES



SET SWITCH AS ABOVE FOR
99V - 132V SUPPLIES

OT/LS - OPEN TORQUE/LIMIT SWITCH.
CT/LS - CLOSE TORQUE/LIMIT SWITCH.

OAS - OPEN AUXILIARY SWITCH.

CAS - CLOSE AUXILIARY SWITCH.

IAS1 & 2 - INTERMEDIATE AUXILIARY

SWITCHES ADJUSTABLE TO MAKE OR
BREAK INDIVIDUALLY AT ANY POSITION.

WIRES ARE IDENTIFIED AT EACH END BY
TERMINAL NUMBER OR NUMBER SHOWN.

FS1 - 6.3A


FS2 - 250mA

FS3 - 160mA

TERMINALS 4 & 5 FUSED

INTERNALLY AT 160mA

E.S.D. CONTROL SIGNAL VOLTAGE MUST
BE EQUAL TO OR GREATER THAN ALL
OTHER CONTROL SIGNAL VOLTAGES.

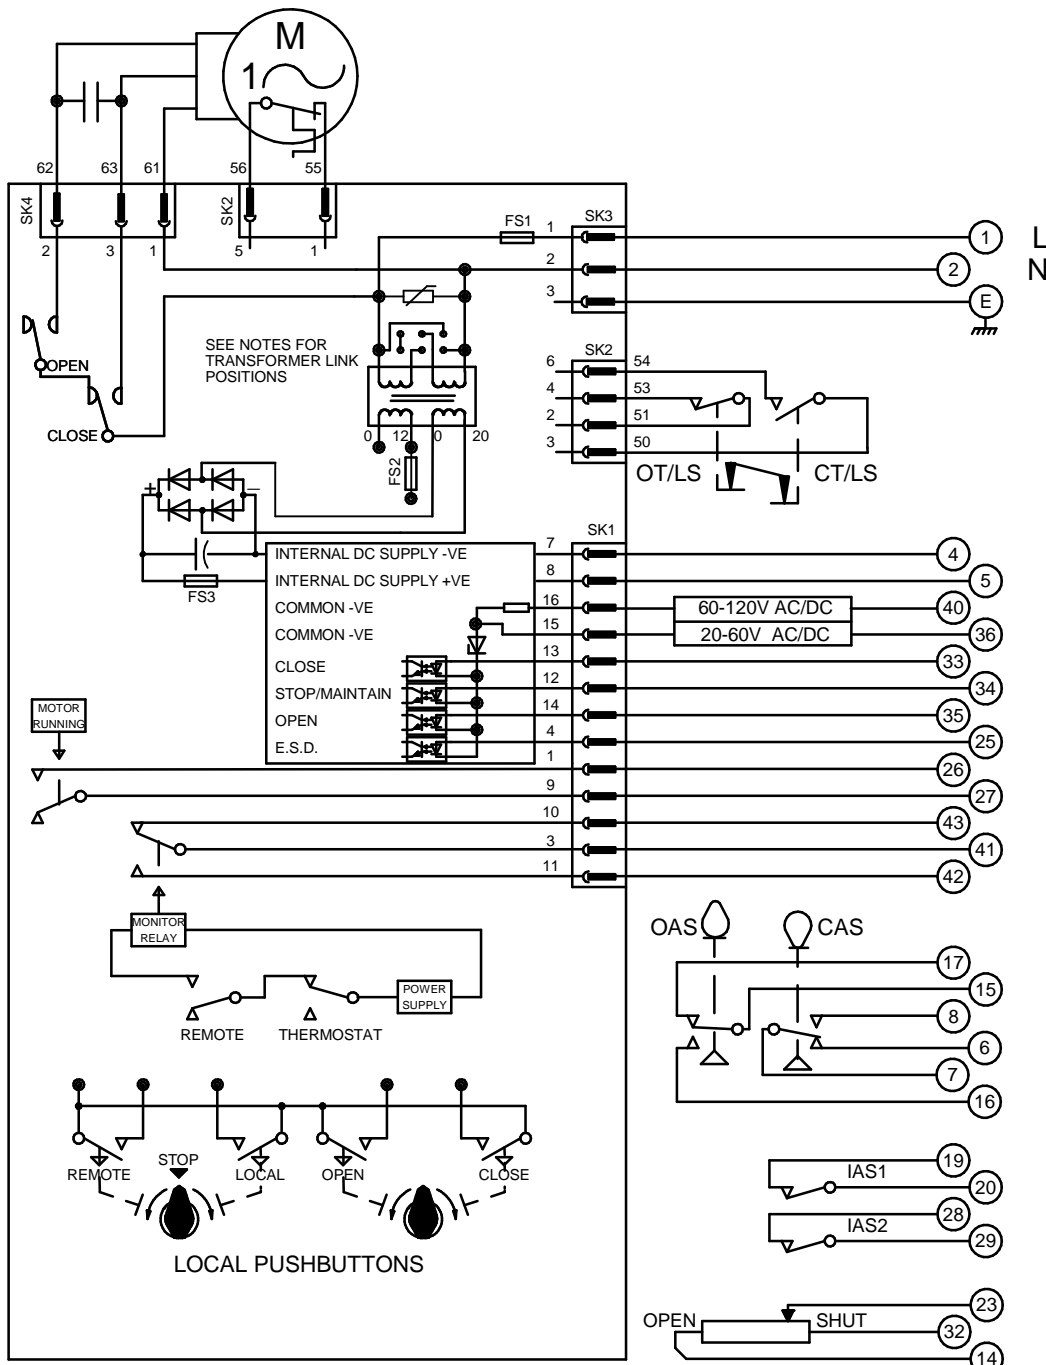

Iss	Date	Chkd	Revision Details
02	220192	T.W	SIMILAR TO 1P06Q00 JOB NO --- SK1 & SK4 PIN NOD CORRECTED. CHECKED K.S.
03	270417	JS	FUSE RATING & TRANSFORMER VOLTAGE SELECTION CHANGED AS PER NEW PCB ECN / 7023

www.rotork.com

ROTORK CONTROLS LTD
BATH, BA1 3JQ
ENGLAND
Tel:01225-733200

ROTORK CONTROLS INC
ROCHESTER
NY 14624, USA
Tel:585-247-2304

Q-PAK + 2 INTERMEDIATE SW + POTENTIOMETER.	
Drawn by: K.S Date : 040490 Base WD: 1P06Q00 Job No : -- MI No : .	Circuit Diagram No 1P06Q00 Issue No 3