

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION


Circuit Diagram No - Issue No

2P02Q30 - 4

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION


WARNING

IT IS ESSENTIAL THAT REMOTE CONTROL CIRCUITS ARE DESIGNED SO THAT AN OPEN AND A CLOSE SIGNAL CAN NEVER BE APPLIED SIMULTANEOUSLY.

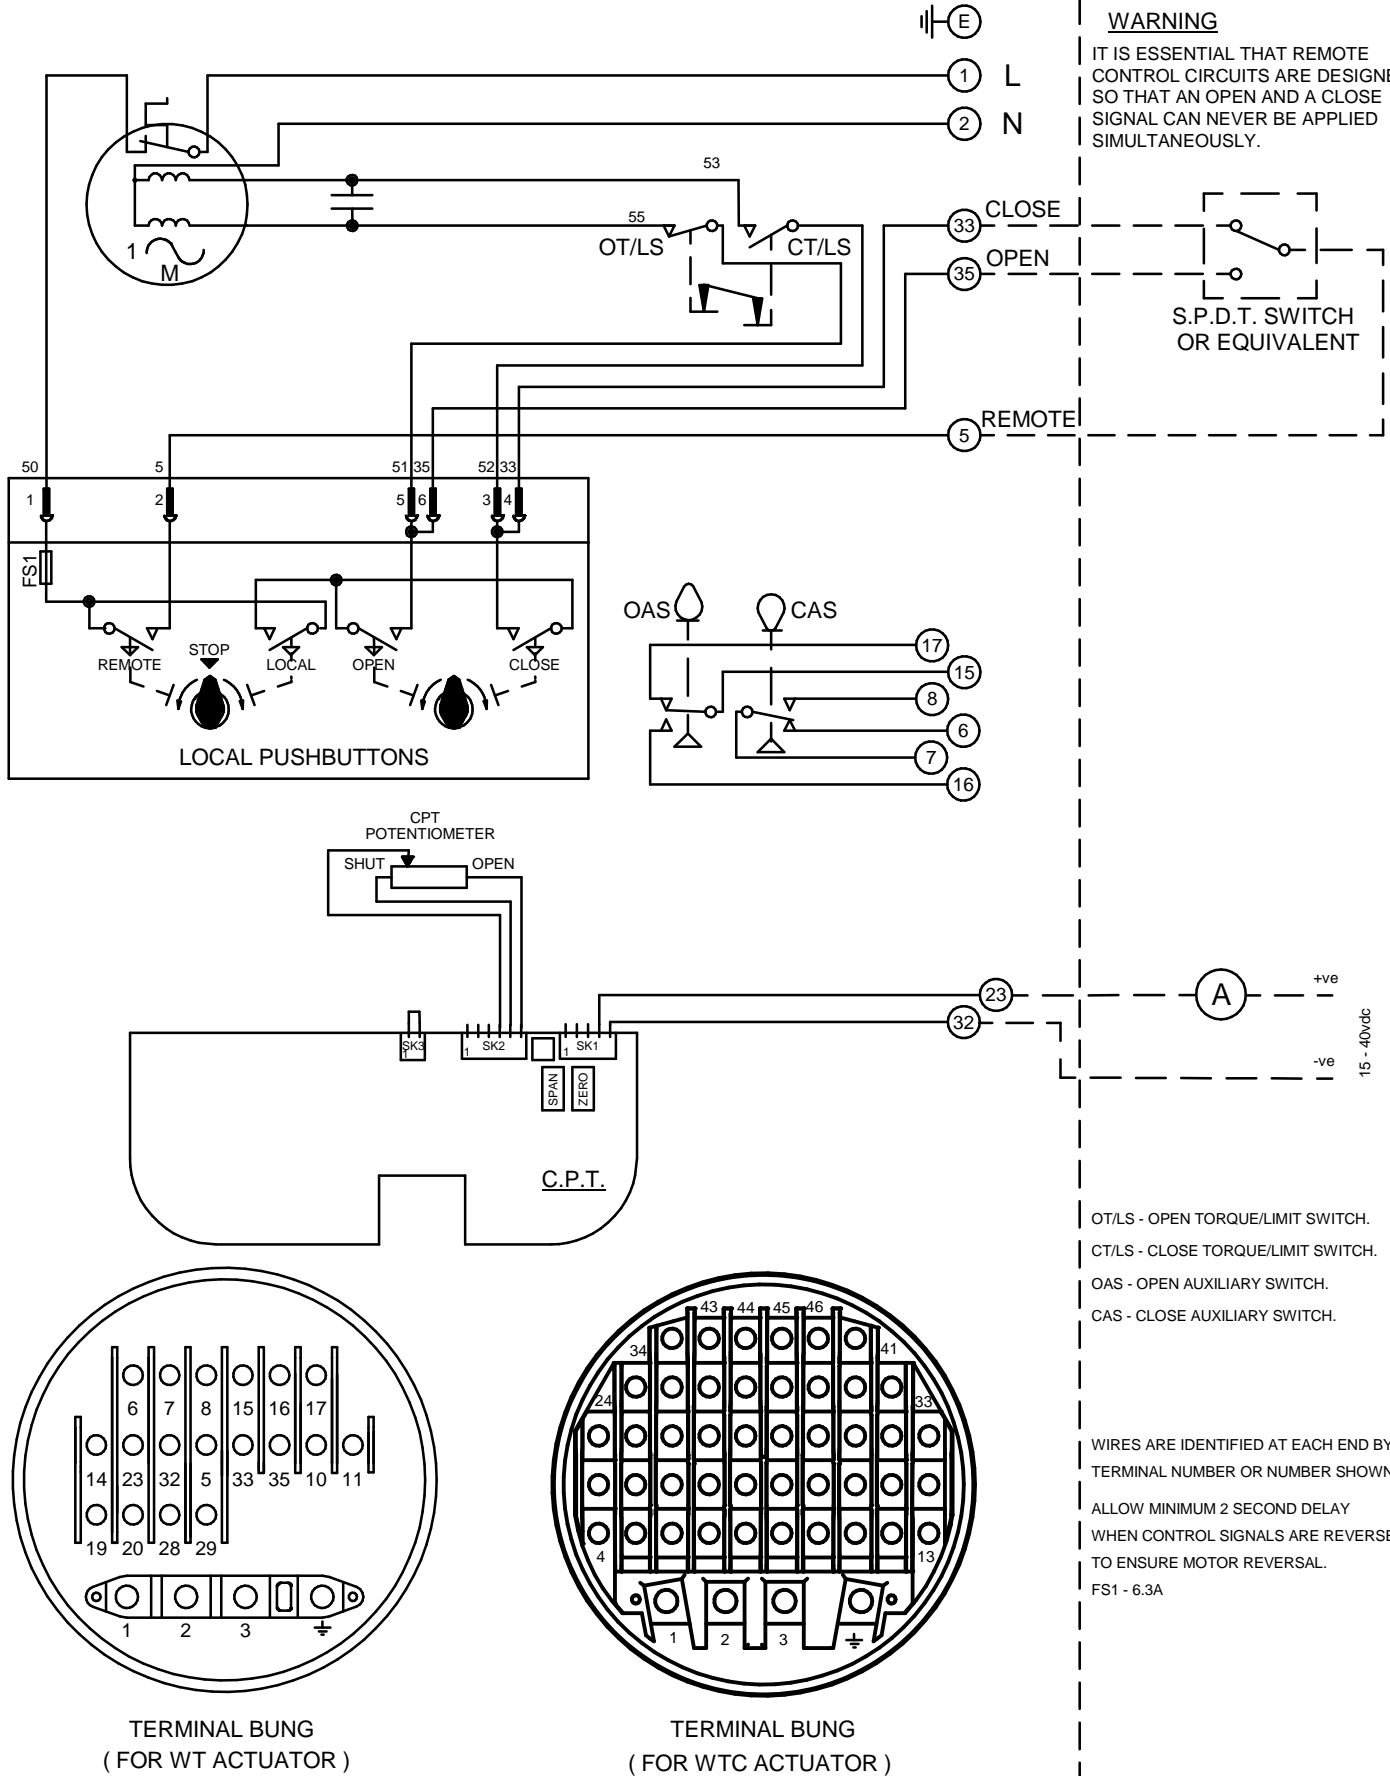

S.P.D.T. SWITCH OR EQUIVALENT

LOCAL PUSHBUTTONS

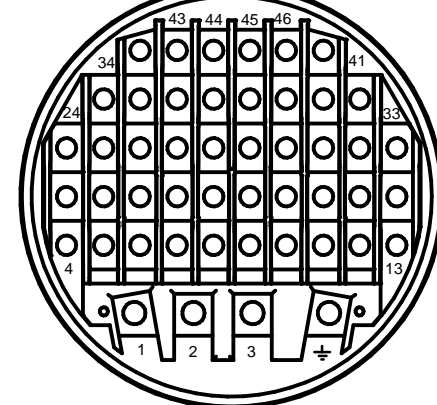

TERMINAL BUNG (FOR WTC ACTUATOR)

OT/LS - OPEN TORQUE/LIMIT SWITCH.
 CT/LS - CLOSE TORQUE/LIMIT SWITCH.
 OAS - OPEN AUXILIARY SWITCH.
 CAS - CLOSE AUXILIARY SWITCH.

WIRES ARE IDENTIFIED AT EACH END BY TERMINAL NUMBER OR NUMBER SHOWN.
 ALLOW MINIMUM 2 SECOND DELAY WHEN CONTROL SIGNALS ARE REVERSED TO ENSURE MOTOR REVERSAL.
 FS1 - 6.3A

Iss	Date	Chkd	Revision Details
02		PGS	SIMILAR TO 2P02Q30 JOB NO ----
03	190292	T.W	WARNING NOTE ADDED. CHECKED K.S 190292
04	260417	JS	PAK TERMINAL BUNG INTRODUCED FOR WTC APPLICATION EC7024.

www.rotork.com

ROTORK CONTROLS LTD
 BATH, BA1 3JQ
 ENGLAND
 Tel:01225-733200

ROTORK CONTROLS INC
 ROCHESTER
 NY 14624, USA
 Tel:585-247-2304

Q - STANDARD + PUSHBUTTONS + POT.+ EXT. POWERED C.P.T.	
Drawn by: P.W Date : 230590 Base WD: 2P02Q30 Job No : --- MI No : .	Circuit Diagram No 2P02Q30 Issue No 4