



working for a safer tomorrow

KARANDIKAR LABORATORIES PVT. LTD. BOISAR

Format: F#07 b.1 Rev 10

TYPE TEST REPORT

IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)
Degrees of Protection Provided by Enclosures (IP Code)

Report No. : **KLPL/BTG/22/07-20**
ULR No. : **TC631122000000345F**
Discipline : **Electrical Discipline**
Group/Category : **Environmental Test Facility**
Sub-category : **Ingress protection test**



Date of issue..... : **13.07.2022**
No. of pages : **06 PAGES + Annexure**
Compiled by (+ signature)..... : **Rohit Patil**
Designation: **Testing Engineer**

Approved by (+ signature)..... : **Javed Shaikh**
Designation: **Dy.Laboratory Manager**

Item Received On : **04.07.2022 in Good Condition**

Test Completion Date : **11.07.2022**

Client

Name : **M/s. Rotork Control (India) Pvt. Limited.**
: **28B, Ambattur Industrial Estate (North), Ambattur,**
: **Chennai - 600 098, India.**

Test Specification

Standard : **IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)**
Specified IP-Code : **IP68**


Equipment Under Test

Type of Test Object : **CKQ Range Of Actuator**
Model No. : **CKQ135**
Sr. No..... : **S000286001**
Manufacturer : **M/s. Rotork Control (India) Pvt. Limited .**

Annexure :

Drawing No..... : **BR/MISC-11794, Rev No.00, Dated:11.07.2022(03 Pages)**

- NOTE : 1) This refers only to the particular item(s) submitted for testing.**
2) If necessary, this report shall be reproduced ONLY in full.



Head Office: B-101, Ansa Industrial Estate, Saki Vihar Road, Saki Naka, Andheri (E) Mumbai-400072 INDIA Ph: (022) 28471395
Laboratory: Gat#142, Betegaon, Boisar Chillhar Road, Opp. Union Park, Boisar (E) Tal-Palghar, Dist-Palghar-401501, INDIA
Phone (02525) 284881/931

Email: sales@karandikarlab.com

Website: www.karandikarlab.com



working for a safer tomorrow

KARANDIKAR LABORATORIES PVT. LTD. BOISAR

Report No.: KLPL/BTG/22/07-20

Date: 13.07.2022

Possible test case verdicts:

Test case does not apply to the test object : N (Not Applicable)

Test object does meet the requirement..... : P (Pass)

Test item does not meet the requirement : F (Fail)

Test case has not been checked : _____

General remarks:

"(See remark #)" refers to a remark appended to the report.

"(See appended table)" refers to a table appended to the report.

Throughout this report a point is used as the decimal separator.

The test results presented in this report relate only to the object tested.

This test report shall not be reproduced except in full without the written approval of the testing

Laboratory.

IP6X test conducted at Laboratory (Boisar).

IPX8 test conducted at Laboratory (Boisar).

Note: - MAJOR EQUIPMENTS USED

Tests	Required Instruments	Id. No.	Cal Due Date	Used Y/N
5X / 6X	Vacuum Meter	K&A 1108/1-17	04.02.2023	Y
	Rotameter	K&A 426	02.01.2023	Y
	Timer	K&A 581/1-12	08.08.2022	Y
	DTC with sensor	K&A 581/2-12	01.08.2022	Y
X7 /X8	Scale	K&A 107	29.09.2022	Y
	Stop watch	K&A 1128-18	15.01.2023	Y





working for a safer tomorrow

KARANDIKAR LABORATORIES PVT. LTD. BOISAR

Report No.: KLPL/BTG/22/07-20

Date: 13.07.2022

IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)

Clause	Requirement - Test	Result- Remark	Verdict
10	Marking.	--	N
11	General requirement for tests.		
11.1	Tests should be carried out under the standard atmospheric conditions described in IEC 60068-1	--	P
11.2	Test samples shall be in a clean and new condition.	--	P
	The relevant product standard shall specify details such as: The number of samples to be tested;	--	N
	-conditions for mounting, assembling and positioning of the samples;	--	P
	-the pre-conditioning, if any, which is to be used;	--	N
	-whether to be tested energized or not;	--	N
11.5	Empty enclosures		
	If the enclosure is tested without equipment inside, the manufacturer shall ensure that after the electrical equipment is enclosed the enclosure meets the declared degree of Protection of the final product.	--	N

12	Tests for protection against access to hazardous parts indicated by the first characteristic numeral.				
First, characteristic Numeral.	Test means (Access probes)	Test force	Test Conditions Refer IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)	--	
0	No test required	-	-	--	N
1	The access probe, sphere of 50 mm Ø shall not fully penetrate and adequate clearance shall be kept.	50N ±10%	Cl.12.2	--	N
2	The jointed test finger may penetrate up to 80 mm length but adequate clearance shall be kept.	30N ±10%	Cl.12.2	--	N
3	The access probe, sphere of 2.5 mm Ø shall not penetrate and adequate clearance shall be kept.	3N± 10%	Cl.12.2	--	N
4	The access probe of 1,0 mm Ø shall not penetrate and adequate clearance shall be kept.	1N± 10%	Cl.12.2	--	N
5	Test conditions for IP 5X: Same As Above	1N± 10%	Cl.12.2	--	N
6	Test conditions for IP 6X: Same As Above	1N± 10%	Cl.12.2	--	N



Head Office: B-101, Ansa Industrial Estate, Saki Vihar Road, Saki Naka, Andheri (E) Mumbai-400072 INDIA Ph: (022) 28471395
 Laboratory: Gat#142, Betegaon, Boisar Chilhar Road, Opp. Union Park, Boisar (E) Tal-Palghar, Dist Palghar-401501, INDIA Phone (02525) 284881/931

Email: sales@karandikarlab.com

Website: www.karandikarlab.com

IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)					
Clause	Requirement – Test			Result-Remark	Verdict
13	Tests for protection against solid foreign objects indicated by the First characteristic numeral.				
First, characteristic Numeral.	Test means (object probes and dust chamber)	Test force	Test Conditions Refer IEC 60529: 2013 & IS/IEC 60529:2001 (RA 2019)	--	
0	No test required	-	-	--	N
1	Rigid sphere without handle or guard 50 mm diameter.	50N ±10%	Cl.13.2	--	N
2	Rigid sphere without or guard 12, 5 mm diameter.	30N ±10%	Cl.13.2	--	N
3	Rigid steel rod 2,5mm diameter with edges free from burrs	3N± 10%	Cl.13.2	--	N
4	Rigid steel wire 1, mm diameter with edges free from burrs.	1N± 10%	Cl.13.2	--	N
5	Dust chamber, with under pressure	NA	Cl.13.4+13.5	--	N
6	Dust chamber, The enclosure is maintained below the Surrounding atmospheric pressure by a vacuum pump.	NA	Cl.13.4+13.6	For 8 hrs. As extraction rate is less than 40 Volumes per hour and max depression of 20mbar.	P
13.6.2	Acceptance conditions for the first characteristic numeral 6X. The protection is satisfactory if no hazardous deposit of dust is observable inside the UUT at the end of test.			No ingress of powder found inside the UUT.	P



IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)				
Clause	Requirement – Test		Result-Remark	Verdict
14	Tests for protection against water indicated by the second characteristic numeral.			
Second, characteristic Numeral.	Test means	Test Conditions Refer IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)	--	
0	No test required	Cl.14.2.0	--	N
1	Drip box, Enclosure on turntable	Cl.14.2.1	--	N
2	Drip box, Enclosure in 4 fixed positions of 15 ° tilt	Cl.14.2.2	--	N
3	oscillating tube or spray nozzle, 60° from vertical	Cl.14.2.3	--	N
4	oscillating tube or spray nozzle, 180° from vertical	Cl.14.2.4	--	N
5	6.3-mm nozzle, tested with a spraying nozzle, distance 2.5 m to 3 m, water flow rate 12.5 l/min	Cl.14.2.5	--	N
6	12.5-mm nozzle, tested with a spraying nozzle, distance 2.5 m to 3 m, water flow rate 100 l/min	Cl.14.2.6	--	N
7	Immersion tank,	Cl.14.2.7	--	N
8	Immersion tank, Continuous immersion subject to agreement. Water temperature does not differ from that of equipment by more than 5K. Test Duration: 96 Hrs	Cl.14.2.8	The lowest point of UUT is located 8 meter below surface of water.	P
-	Acceptance conditions for IPX8: The protection is satisfactory if no water has accumulated near the insulation, cable end or entered cables or interferes with the correct operation of the equipment.	Cl.14.3	No ingress of water observed inside the UUT.	P
-	Tests for protection against access to hazardous parts indicated by the additional letter.	Cl.15	--	N

SUMMARY OF INGRESS PROTECTION TESTS ACCORDING TO IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)

Conclusion of the IP68 test: PASS.

The results of the tests were in compliance with the requirements in the standard

IEC 60529:2013 & IS/IEC 60529:2001 (RA 2019)

UUT=Unit Under Test





Picture1: CKQ Range of Actuator




Pictute2: No ingress of powder & water observed

END OF REPORT



"O" RING LOCATION	DMENSIONS	MATERIAL
HAND WHEEL COVER (1)	82.27 x 1.78	NITRILE
CENTRONIK UNIT COVER (2)	115 x 3	NITRILE
INDICATOR WINDOW (3)	54 x 1.50	NITRILE
MOTOR HOUSING (4)	94.97 x 1.78	NITRILE
MOTOR END CAP (5)	26.7 x 1.78	NITRILE
TERMINAL BUNG (6)	115 x 3	NITRILE
BASE (7)	79 x 1.78	NITRILE
CENTRONIK UNIT END CAPS (8)	155 x 3	NITRILE
MSM UNIT COVER (9)	136 x 3	NITRILE
CENTRONIK UNIT DISPLAY (10)	RECT 77 x 86 x 3	NITRILE


THE CLEARANCE BETWEEN THE SPIGOT AND BORE IS
 MIN. - 0.05 mm
 MAX. - 0.30 mm

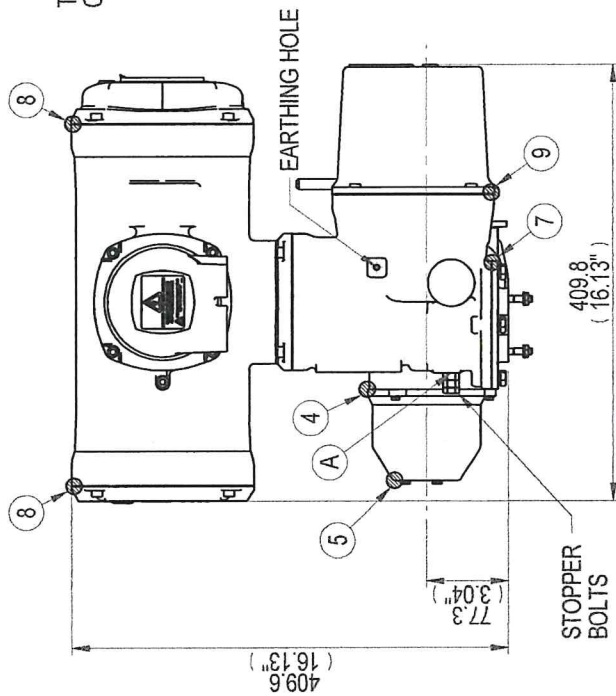


NOTES:

- APPROXIMATE WEIGHT OF THE ACTUATOR IS 21 KG
- ALL CONDUIT ENTRIES ARE PLUGGED WITH WEATHER PROOF PLUGS.
- ALL "O" RINGS ARE ASSEMBLED AFTER APPLYING GREASE
- Ⓐ OIL FILTERS AND DRAIN PLUGS

CENTRONIK UNIT

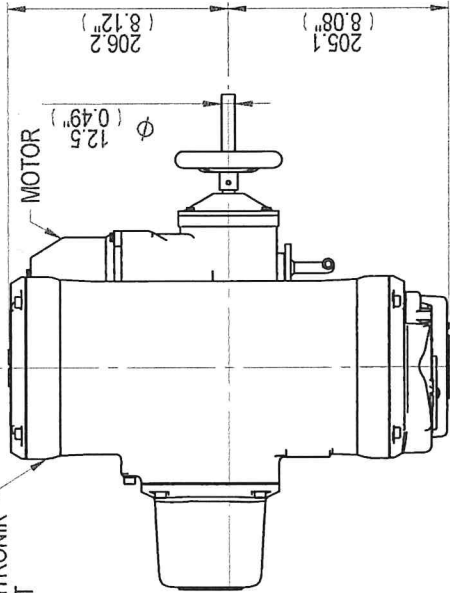



PUSH BUTTON / SELECTOR ASSEMBLY

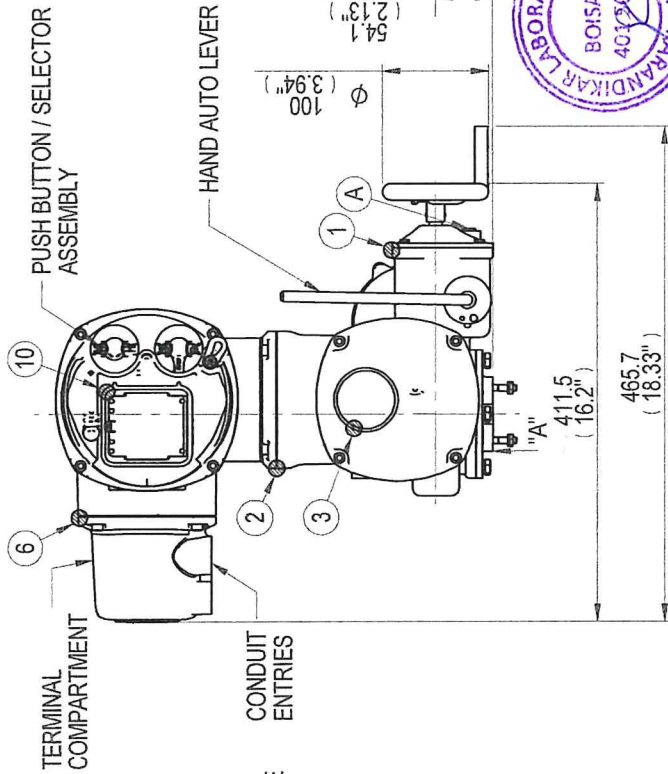

TERMINAL COMPARTMENT

CONDUIT ENTRIES


HAND AUTO LEVER

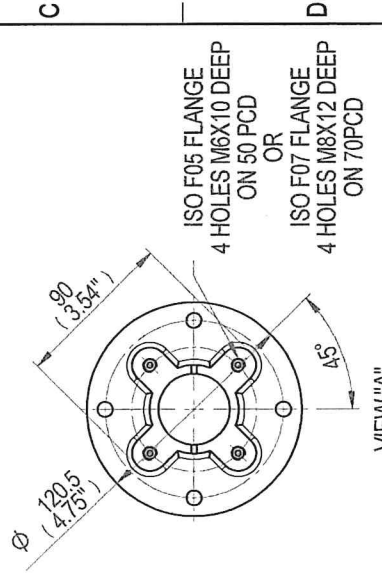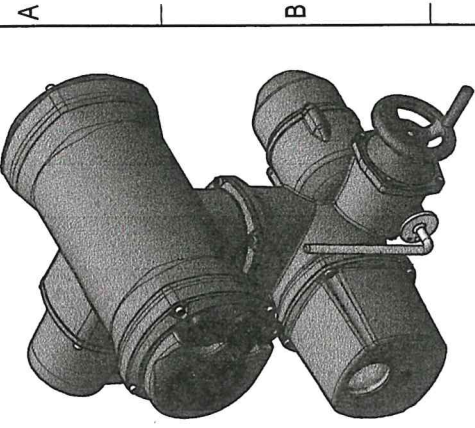

ISO F05 FLANGE
 4 HOLES M6X10 DEEP
 ON 50 PCD

OR
 ISO F07 FLANGE
 4 HOLES M8X12 DEEP
 ON 70PCD

VIEW "A"

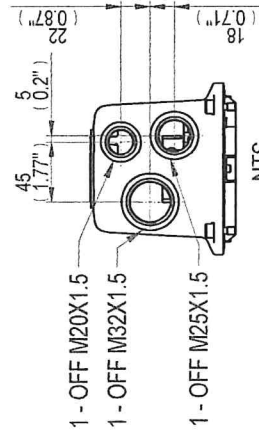

1 - OFF M20X1.5

1 - OFF M32X1.5

1 - OFF M25X1.5

NTS



Report No: KLPLIBTA/22/03-20







rotork
 Chemical - India
 www.rotork.com

© 2023 Rotork Group of Companies. All rights reserved. This document and its contents may not be reproduced, distributed, transmitted, displayed, published, or broadcast, in whole, or in part, without the prior express written permission of Rotork Group of Companies.

Created	ALLEN MARSH B	2022-07-11	2022-07-11	2022-07-11
Checked	ALLEN MARSH B	2022-07-11		
Approved	RANJIB S.B.S.U D			

Dimensions in mm
 Scale 1:6
 Title CKQ135 - CENTRONIK IP68 APPROVAL DRAWING
 Drawing Number BR/MISC-11794
 Normal Mass - 7
 Size A3
 Sheet 1 of 3

Change Description

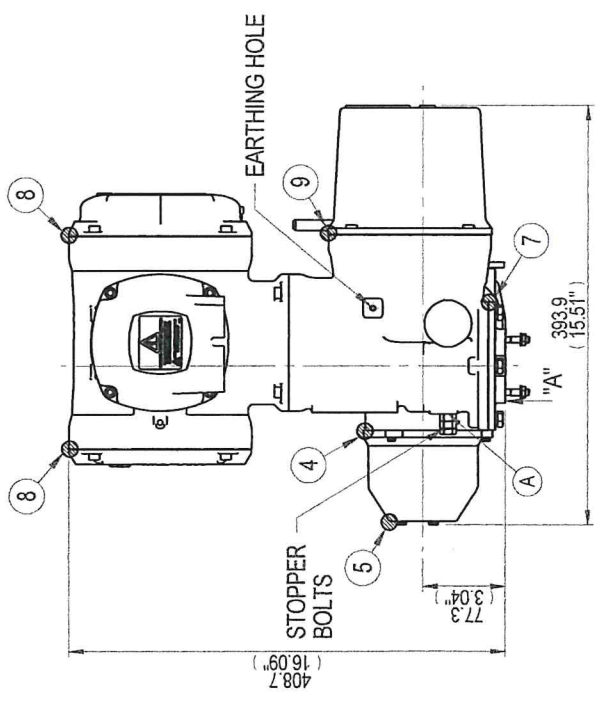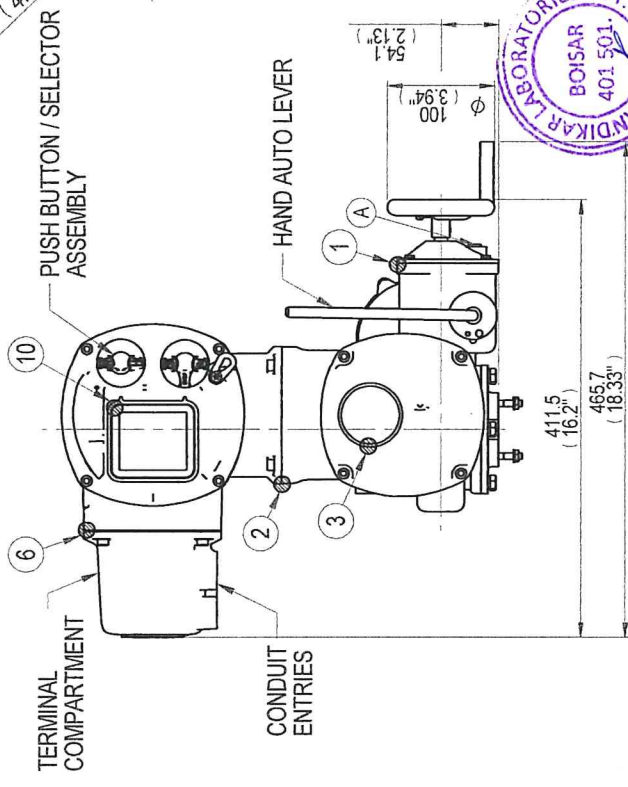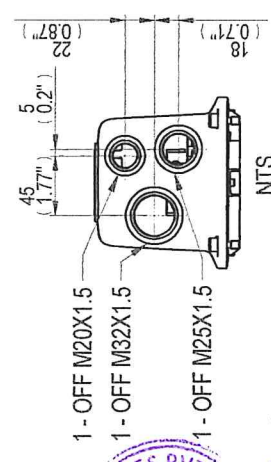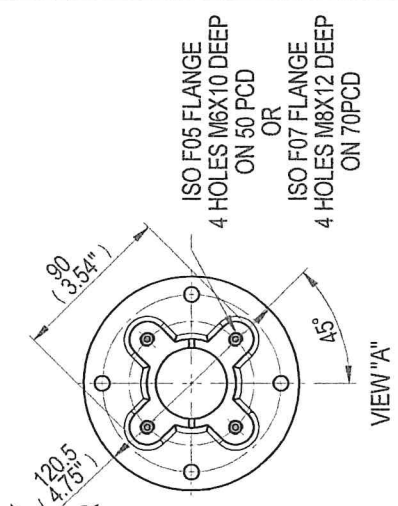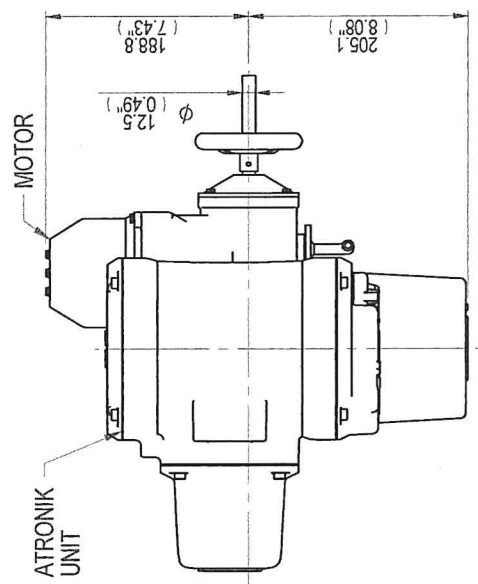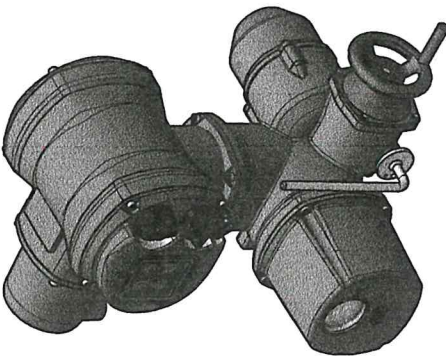

"O" RING LOCATION	DMENSIONS	MATERIAL
HAND WHEEL COVER (1)	82.27 x 1.78	NITRILE
ATRONIK UNIT COVER (2)	115 x 3	NITRILE
INDICATOR WINDOW (3)	54 x 1.50	NITRILE
MOTOR HOUSING (4)	94.97 x 1.78	NITRILE
MOTOR END CAP (5)	26.7 x 1.78	NITRILE
TERMINAL BUNG (6)	115 x 3	NITRILE
BASE (7)	79 x 1.78	NITRILE
ATRONIK UNIT END CAPS (8)	155 x 3	NITRILE
MSM UNIT COVER (9)	136 x 3	NITRILE
ATRONIK UNIT DISPLAY (10)	RECT 77 x 86 x 3	NITRILE

THE CLEARANCE BETWEEN THE SPIGOT AND BORE IS
 MIN. - 0.05 mm
 MAX. - 0.30 mm

NOTES:

- APPROXIMATE WEIGHT OF THE ACTUATOR IS 19 KG
- ALL CONDUIT ENTRIES ARE PLUGGED WITH WEATHER PROOF PLUGS.
- ALL "O" RINGS ARE ASSEMBLED AFTER APPLYING GREASE
- Ⓐ OIL FILTERS AND DRAIN PLUGS

rotork
 Chemical - India
 www.rotork.com

© 2022 Rotork Group of Companies. All rights reserved. This document is the property of Rotork Group of Companies. It is not to be reproduced, published or broadcast, in whole or in part, without the prior express written permission of Rotork Group of Companies.

Created: ALLEN/MARSH B
 Checked: ALLEN/MARSH B

Approved: ANAND BABU D

Scale: 1:5
 Dimensions in mm

Title: CKQ135 - ATRONIK IP68 APPROVAL DRAWING

Report No: KIPLIBTG/22107-20

Drawing Number: BR/MISC-11794

Rev: 00

11-07-22 FIRST ISSUE



14-07-22 FIRST ISSUE

11-07-22 FIRST ISSUE

11-07-22 FIRST ISSUE


Rev	ECN	Revised	Rev. Approved	Date	Change Description
00				11-07-22	FIRST ISSUE
				14-07-22	FIRST ISSUE
				11-07-22	FIRST ISSUE
				11-07-22	FIRST ISSUE

Amhax22


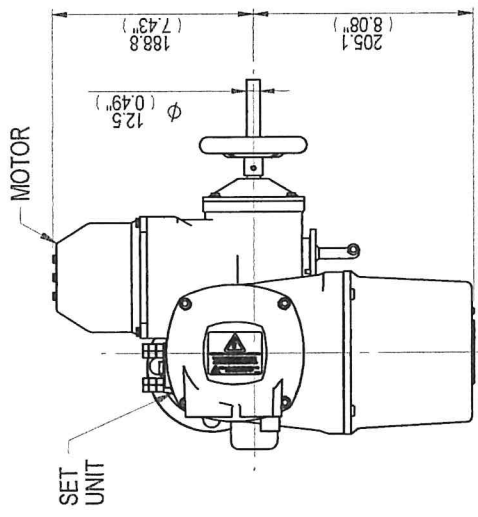
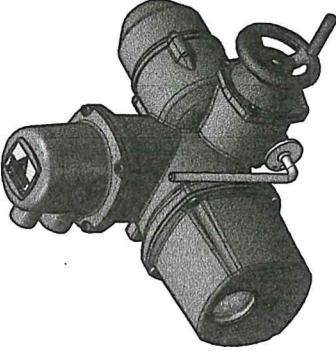


"O" RING LOCATION	DMENSIONS	MATERIAL
HAND WHEEL COVER (1)	82.27 x 1.78	NITRILE
TERMINAL BUNG (2)	115 x 3	NITRILE
INDICATOR WINDOW (3)	54 x 1.50	NITRILE
MOTOR HOUSING (4)	94.97 x 1.78	NITRILE
MOTOR END CAP (5)	26.7 x 1.78	NITRILE
BASE (6)	79 x 1.78	NITRILE
MSM COVER (8)	136 x 3	NITRILE

THE CLEARANCE BETWEEN THE SPIGOT AND BORE IS
 MIN. - 0.05 mm
 MAX. - 0.30 mm

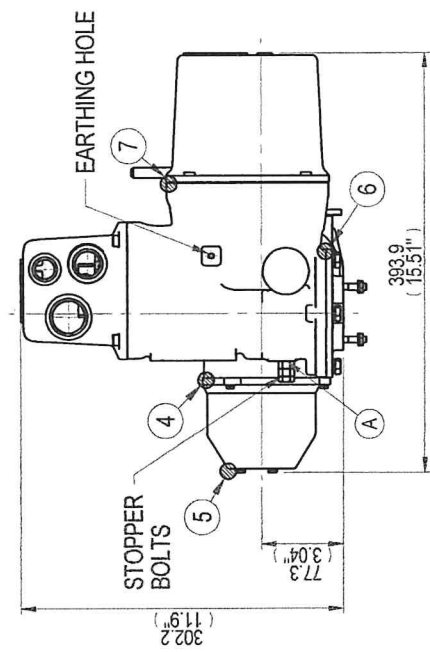

- NOTES:
- APPROXIMATE WEIGHT OF THE ACTUATOR IS 13 KG
 - ALL CONDUIT ENTRIES ARE PLUGGED WITH WEATHER PROOF PLUGS.
 - ALL "O" RINGS ARE ASSEMBLED AFTER APPLYING GREASE
 - Ⓐ OIL FILTERS AND DRAIN PLUGS

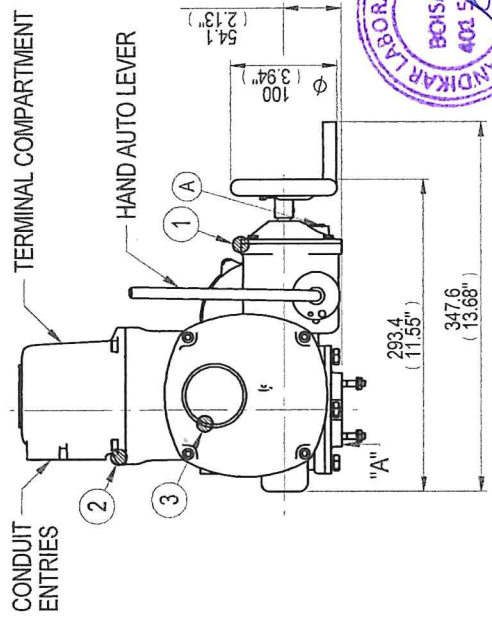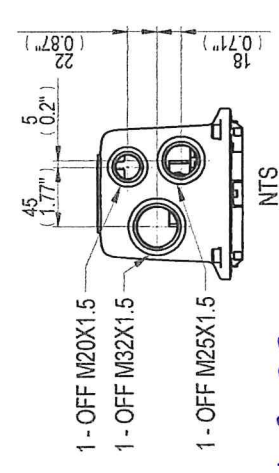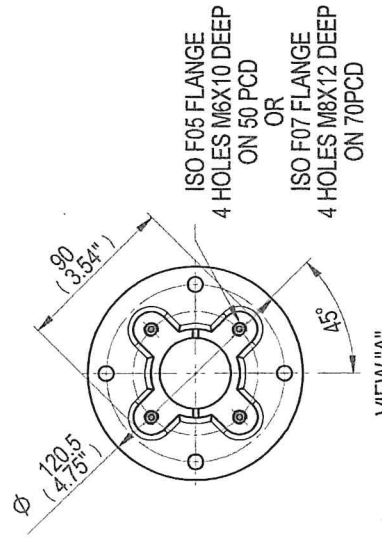

Report NO: KIP11BTG/22107-20

rotork
 Chennai - India
 www.rotork.com

© 2022 Rotork Group of Companies
 All rights reserved. This document and its contents may not be reproduced, distributed, transmitted, displayed, published or broadcast, in whole or in part, without the prior express written permission of Rotork Group of Companies.

rotork
 CKQ135 - BASIC
 IP68 APPROVAL DRAWING

Dimensions in mm
 Scale 1:6

Created ALLEN MARCH B
 Checked ALLEN MARCH B
 Approved ANAND GUELD

2022-07-11
 2022-07-11
 2022-07-11

Drawing Number
BR/MISC-11794

Rev 00

Rev	ECN	Revised	Rev. Approved	Date	Change Description
00				11-07-22	FIRST ISSUE